

Product Information NFP-41

FOOD

Level Detector with integrated Temperature Sensor NFP-41



Application / Specified Usage

- Level detection and temperature measurement in one device

Application Examples

- Dry running and temperature protection in pipes
- Level detection and temperature measurement in vessels

Hygienic Design / Process Connection

- Hygienic process connection with CLEANadapt
- Versions available with EHEDG approval
- Versions available to conform to 3-A Standard 74-
- All wetted materials are FDA-conform
- Sensor completely made of stainless steel
- Complete overview of process connections: see order code
- The Anderson-Negele CLEANadapt system offers a flow-optimized, hygienic and easily sterilizable installation solution for sensors.


Features

- CIP-/SIP-cleaning up to 143 °C / 289 °F, max. 120 minutes
- Level detection and temperature measurement in one measurement point
- Available with or without integrated electronic

Options / Accessories

- Integrated temperature and level electronic (MNV-1)
- Readymade connecting cable for M12 plug

Communication

 **4...20 mA**

Temperature sensor NFP-41



Specification NFP-41		
Process connection	conforming to 3-A and EHEDG	CLEANadapt G1/2"
Insertion length		29 mm
Material	head protection tube M12 plug insulator	stainless steel 1.4301 / AISI 304 stainless steel 1.4404 / AISI 316L stainless steel 1.4301 / AISI 304 PEEK (FDA approval number 21CFR177.2415)
Sensing resistor	acc. ITS 90	1x Pt100 class A
Protection class		IP 69 K
Temperature range	ambient sensor tip CIP/SIP	-50...80 °C / -58...176 °F -50...150 °C / -58...302 °F up to 143 °C / 289 °F, 120 min
Operating pressure		max. 10 bar / 145 psi
Electrical connection	plug-in connection	M12 plug, 5 pin
Thread size G1/2"	Sealing system PEEK	10 Nm torque max.

Level Module MNV-1		
Temperature	operating storage	-10...80 °C / -14...176 °F -20...90 °C / -4...194 °F
Humidity	without condensate	0...95 %
Supply		15...36 V DC
Sensor measurement		free of DC voltage
Sensitivity	MNV-1	0.1; 1; 10; 100 kΩ selectable
Output	short-circuit-proof	active 50 mA
Delay	fix	0.5 s
Switching logic	MNV-1	via jumpers (full/empty selectable)

Accuracy classes of temperature sensors Tolerances for Pt100 acc. to DIN EN 60751			
Pt100	A	1/3 B	1/10 B
0 °C / 100 Ω	±0.15 K / ±0.06 Ω	±0.10 K / ±0.04 Ω	±0.03 K / ±0.01 Ω
100 °C / 138.5 Ω	±0.35 K / ±0.13 Ω	±0.27 K / ±0.10 Ω	±0.08 K / ±0.03 Ω


Sensor tip diameter and response time

All temperature sensors are available with smaller sensor tips, to ensure a shorter response time. The mentioned times were measured by immersing a temperature sensor from room temperature into boiling water.

The response times given are typical measured values and may vary due to factors such as process connection, immersion length and medium.

Sensor tip Ø 3 mm

50 %-Zeit: $t_{50} \leq 0.5 \text{ s}$
90 %-time: $t_{90} \leq 1.5 \text{ s}$

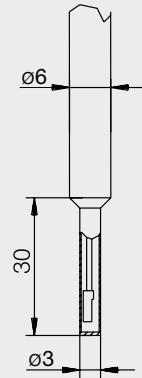

Mounting Instruction

- Take attention of the maximal torque when you build in the sensor!
- To guarantee a safe function, take a look on a good electrical connection between process connection of the sensor and the pipe or vessel.
- **Do not use any kind of sealing band like e.g. TEFLON tape!**
- Using the sensor in pipes for dry running protection, take care that the electrode will emerge if the pipe runs out. We propose to install the sensor in vertical pipes.
- Vessel resp. pipe wall must be made of steel!
- Please mounting and demounting the sensor, please use the spanner flat only! Do not use the connecting head!
- **Do not shorten the electrode!**

General Operating Manual


- Mount the sensor into the fitting and perform wiring according to connection figures.

Startup the level module MNV-1


- Connecting to the voltage supply
- Setup the switching logic: see figure
- Select the lowest sensitivity (0.1 kΩ).
- Wetting the electrode with the medium with the lowest conductivity
- If the output is switching, the setup is finished.
- If the output is not switching, increase the sensitivity until the output is switching. Setup is finished.

Level transmitter MNV-1C

- 1: LED sensor (lights up when the sensor is immersed, independent of the switching function)
- 2: Terminal block
- 3: Full/empty jumper
- 4: Sensitivity jumper

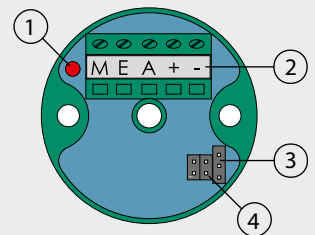

Configuration of the MNV-1C level transmitter

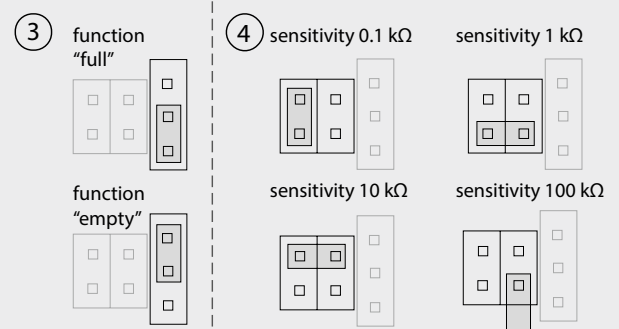


Standard setting on delivery


3: full

4: 10 kΩ

NFP-41

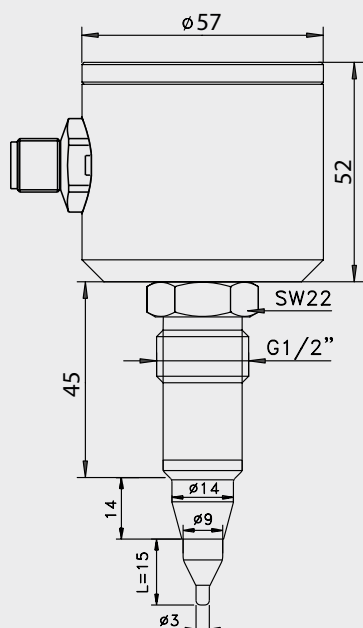

NFP-41 with MNV-1 integrated

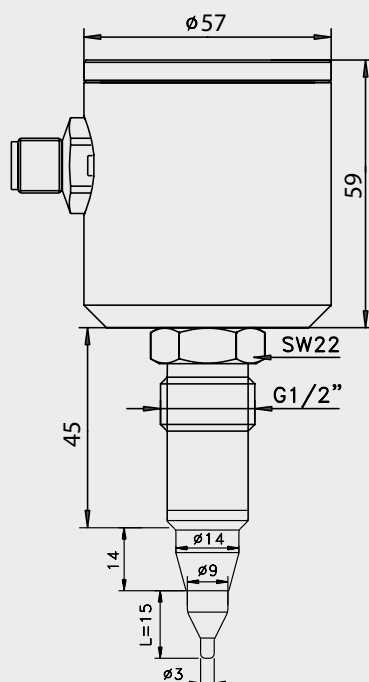

Without level transmitter


1: not connected

2: Pt100


3: GND

4: probe

5: Pt100



With level transmitter and Pt100

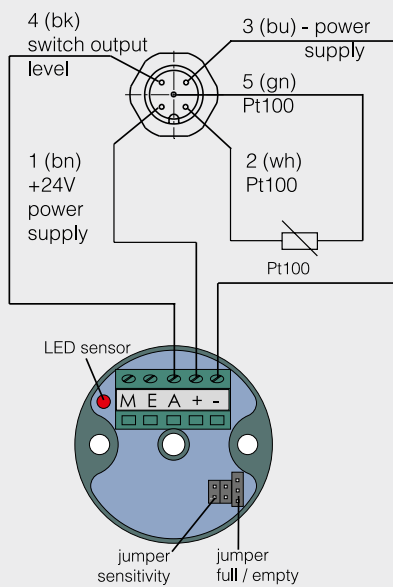

Mechanical connection/Installation

- Use Negele CLEANadapt or FLEXadapt system for safe operation of measuring point!

Conventional Usage

- Not suitable for applications in explosive areas.
- Not suitable for applications in security-relevant equipments (SIL).

Transport / Storage

- No outdoor storage
- Dry and dust free
- Not exposed to corrosive media
- Protected against solar radiation
- Avoiding mechanical shock and vibration
- Storage temperature -55 °C...90 °C / -67...194 °F
- Relative humidity max. 98 %

Reshipment

- Sensors shall be clean and must not be contaminated with dangerous media!
- Use suitable transport packaging only to avoid damage of the equipment!

Cleaning / Maintenance

- In case of using pressure washers, don't point nozzle directly to electrical connections!

Note on CE

- Applicable directives:
Electromagnetic Compatibility Directive 2014/30/EU
- Compliance with the applicable EU directives is identified by the CE label on the product.
- The operating company is responsible for complying with the guidelines applicable to the entire installation.

Standards and Guidelines

- You have to comply with applicable regulations and directives.

Disposal

- Electrical devices should not be disposed of with household trash. They must be recycled in accordance with national laws and regulations.
- Take the device directly to a specialized recycling company and do not use municipal collection points.

Note on 3-A Sanitary Standard 74-

Information on installation according to 3-A standard is available on our website:
www.anderson-negele.com/3A74.pdf

Click on the PDF icon to download the document.

Note on EHEDG Hygienic Standard Type EL Class I

Information on installation according to EHEDG standard and indications for CLEANadapt adapters with leakage holes is available on our website:
www.anderson-negele.com/EHEDG.pdf

Click on the PDF icon to download the document.

Information on CLEANadapt process connections

Please find the complete overview of all adapters available as well as the respective technical data in the product information on CLEANadapt process adapters.

Order Code (Ⓐ: 3-A compliant, Ⓔ: EHEDG approval (only with CLEANadapt adapter with leakage hole))

NFP-41 Ⓐ Ⓔ

Sensor length

015

Sensor length in mm

Electrical connection

M12

M12 plug

Transmitter

X

Without

MNV

Integrated level transmitter

Measurement range temperature transmitter

-10...40

Range -10...40 °C

0...50

Range 0...50 °C

0...100

Range 0...100 °C

0...150

Range 0...150 °C

NFP-41 / 015 / M12 / MNV / 0...150

Accessories

PVC-cable with M12 connection, brass nickel-plated, IP69K, shielded

M12-PVC/5G-8m 5 pin, length 8 m

M12-PVC/5G-15m 5 pin, length 15 m

M12-PVC/5G-30m 5 pin, length 30 m